

Application



Connection of CTM-LBI-BR-.. to Safety Relay ESM-BA..1

EN

from V1.0.0

Contents

1.	About this document.....	3
1.1.	Version	3
1.2.	Scope.....	3
1.3.	Target group	3
1.4.	Supplementary documents	3
1.5.	Notice.....	3
2.	Components/modules used	4
2.1.	EUCHNER	4
3.	Functional description.....	5
3.1.	CTM-LBI-BR.....	5
4.	Safety assessment.....	5
5.	Overview of the connections	6
6.	Basic circuit diagram.....	7
7.	Wiring of the starting behavior on the ESM-BA..1	8
8.	Important note – please observe carefully!	9

1. About this document

1.1. Version

Version	Date	Change/addition	Chapter
01-01/20	15.01.2020	Prepared	All

1.2. Scope




This document describes the connection of the CTM-LBI-BR-.. to the safety relays in the series ESM-BA..1.

1.3. Target group

Design engineers and installation planners for safety devices on machines, as well as setup and servicing staff possessing special expertise in handling safety components.

1.4. Supplementary documents

The overall documentation for this application consists of the following documents:

Document title (document number)	Contents	
Operating instructions (2525462)	Operating instructions transponder-coded safety switch with guard locking CTM-LBI-BR unicode	
Safety Information (2525460)	Information sheet with important safety information	
Possibly enclosed data sheets	Item-specific information about deviations or additions	

1.5. Notice

This application is based on the CTM-LBI-BR-.. operating instructions and the operating instructions for the safety relay ESM-BA..1. Please refer to the operating instructions for technical details and other information.

2. Components/modules used

2.1. EUCHNER

Description	Order number / item number
Safety switches with guard locking and guard lock monitoring with transponder technology	161638 / CTM-LBI-BR-U-AZ-SA-161638
	161496 / CTM-LBI-BR-U-ZZ-SAP-161496
	161639 / CTM-LBI-BR-U-AZ-SA-161639
	161640 / CTM-LBI-BR-U-ZZ-SAP-161640
Safety relay	085610 / ESM-BA201
	097226 / ESM-BA201P
	085613 / ESM-BA301
	097230 / ESM-BA301P
	097224 / ESM-BA701
	097225 / ESM-BA701P

Tip: More information and downloads about the aforementioned EUCHNER products can be found at www.euchner.com. Simply enter the order number in the search box.

3. Functional description

3.1. CTM-LBI-BR-..

The CTM-LBI-BR-.. is an interlocking device with guard locking according to EN ISO 14119. The safety outputs are switched off when guard locking is released (monitoring of the locking element).

The spring-operated guard locking functions in accordance with the closed-circuit current principle. If the voltage is interrupted at the solenoid, the guard locking remains active and the guard cannot be opened directly.

If the guard is open when the power supply is interrupted and is then closed, guard locking remains released. This prevents people from being locked in unintentionally.

Guard locking according to EN ISO 14119 actuated by spring force – released by power-ON (closed-circuit current principle)

Safety function	Guard locking for personnel protection acc. to EN ISO 14119
Reliability values according to EN ISO 13849	Category 4, PL e

In this example the two safe outputs (FO1A and FO1B) on the CTM-LBI-BR-.. are connected to a safety relay ESM-BA..1.

4. Safety assessment

The CTM-LBI-BR-.. features complete monitoring for faults in the safety-relevant parts and in the cables connected (short circuit monitoring by means of pulsed signals on the outputs FO1A and FO1B).

The example achieves PL e in accordance with EN ISO 13849-1 for position monitoring of the locking element of the guard locking device.

A safety assessment for control of guard locking is not part of this example and must be supplemented for the respective machine by the design engineer in accordance with the risk assessment.



Important!

Shutdown of the energy and any necessary monitoring of the shutdown of the energy (feedback loop) causing the hazard are not part of this document and must be added in accordance with the risk assessment for the machine. In this example, the safety evaluation unit without feedback loop and without start button is used. Please refer to the operating instructions of the safety evaluation unit used for more information.

5. Overview of the connections

Pin	Designation	Function	Use in this example
1	FI1B	Enable input, channel 2	Connection to power supply 24 V DC for use as a separate device.
2	UB	Operating voltage, 24 V DC	Connection to power supply 24 V DC
3	FO1A	Safety output, channel 1	Switching off this safety output will result in the direct shutdown of the enable paths (13 – 14, 23 – 24, ...) in the safety relay ESM-BA..1. Important: The actual shutdown of the energy causing a hazard in a machine is not shown in the example and must be added.
4	FO1B	Safety output, channel 2	
5	OD/C	Door monitoring output / communication	Function is not used
6	FI1A	Enable input, channel 1	Connection to power supply 24 V DC for use as a separate device.
7	0 V	Operating voltage, 0 V DC	Connection to power supply 0 V DC
8	IMP	Control input of guard locking solenoid	Activation of the guard locking by switch S1. Important: According to EN ISO 14119, it must be ensured that the hazard posed by a machine is no longer present before the guard locking can be opened.

Table 1: Terminal assignment and contact description

6. Basic circuit diagram

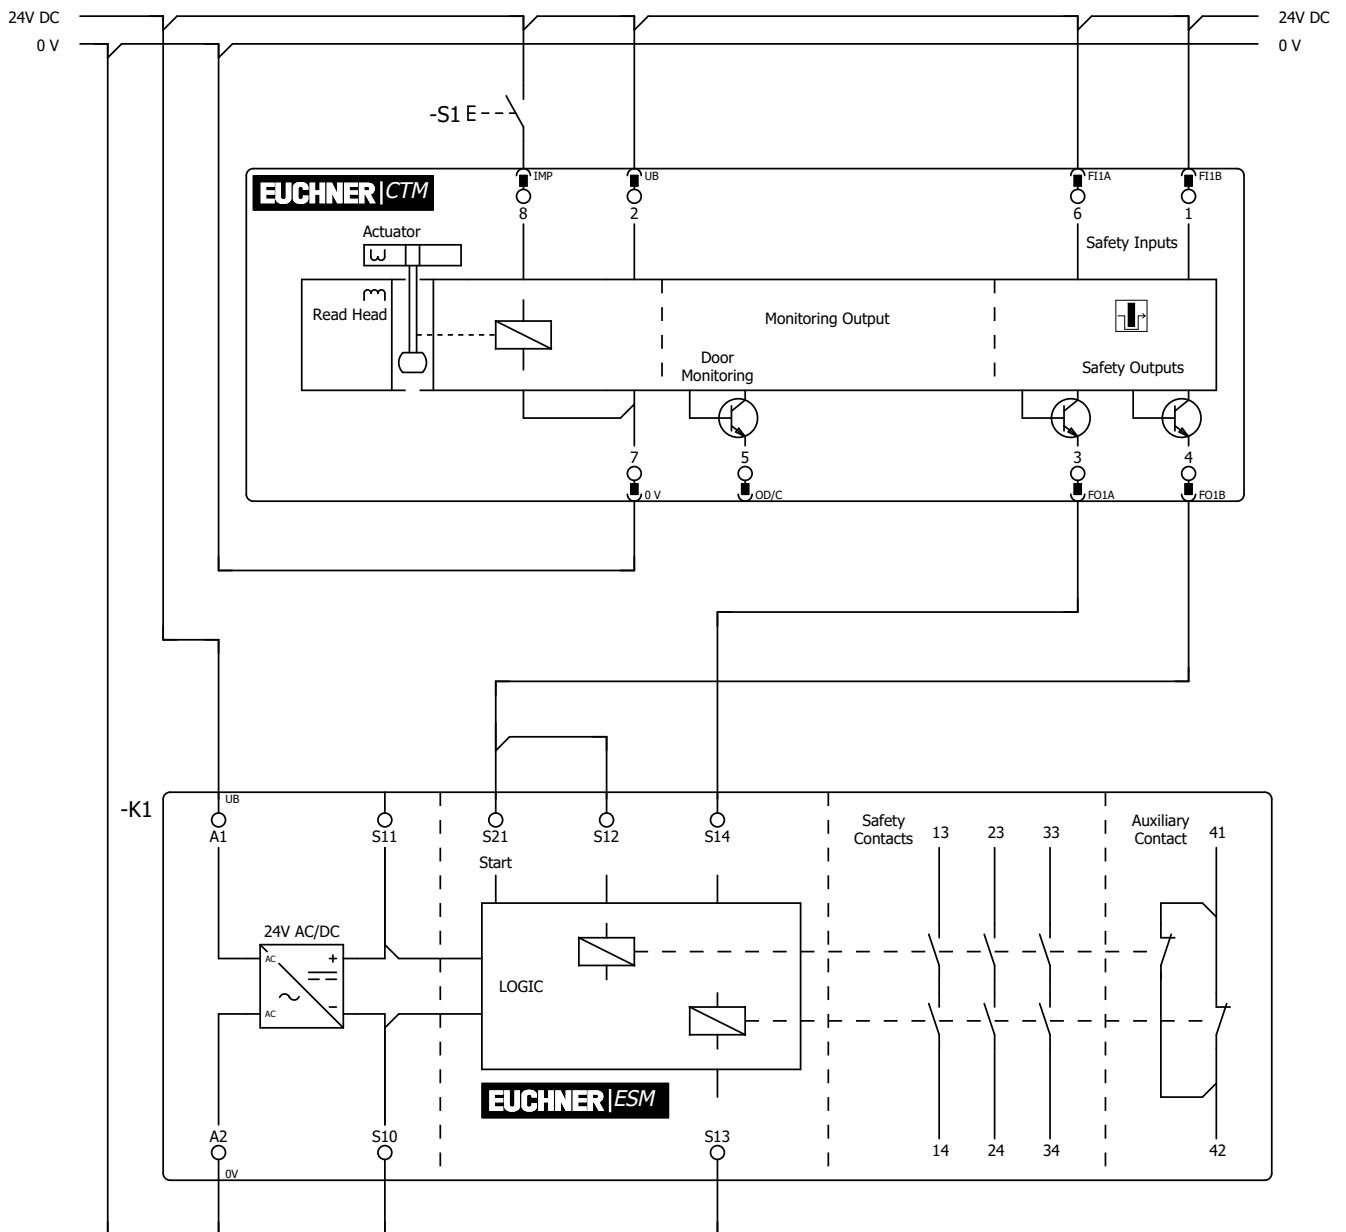


Figure 1: Basic circuit diagram (shown with the ESM-BA301)

7. Wiring of the starting behavior on the ESM-BA..1

With the following settings, the safety relay ESM-BA..1 operates correctly in combination with the CTM-LBI-BR-...

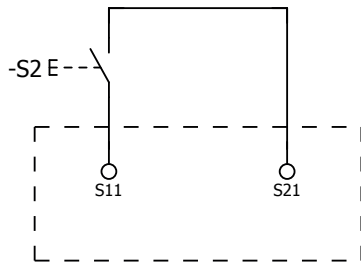


Figure 2: Manual start

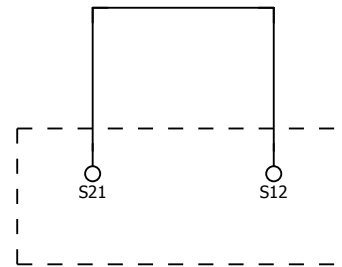


Figure 3: Automatic start

8. Important note – please observe carefully!

This document is intended for a design engineer who possesses the requisite knowledge in safety engineering and knows the applicable standards, e.g. through training for qualification as a safety engineer. Only with the appropriate qualification is it possible to integrate the example provided into a complete safety chain.

The example represents only part of a complete safety chain and does not fulfill any safety function on its own. In order to fulfill a safety function, the energy switch-off function for the danger zone and the software must also be considered in the safety evaluation, for example.

The applications provided are only examples for solving certain safety tasks for protecting safety doors. The examples cannot be comprehensive due to the application-dependent and individual protection goals within a machine/installation.

If questions concerning this example remain open, please contact us directly.

According to the Machinery Directive 2006/42/EC, the design engineer of a machine or installation has the obligation to perform a risk assessment and take measures to reduce the risk. While doing this, the engineer must comply with the applicable national and international safety standards. Standards generally represent the current state-of-the-art. Therefore, the design engineer should continuously inform himself about changes in the standards and adapt his considerations to them. Relevant standards for functional safety include EN ISO 13849 and EN 62061. This application must be regarded only as assistance for the considerations about safety measures.

The design engineer of a machine/installation has the obligation to assess the safety technology himself. The examples must not be used for an assessment, because only a small excerpt of a complete safety function was considered in terms of safety engineering here.

In order to be able to use the safety switch applications correctly on safety doors, it is indispensable to observe the standards EN ISO 13849-1, EN ISO 14119 and all relevant C-standards for the respective machine type. Under no circumstances does this document replace the engineer's own risk assessment, and it cannot serve as the basis for a fault assessment.

In particular in relation to a fault exclusion, it must be noted that a fault can be excluded only by the machine's or installation's design engineer and this action requires justification. A general fault exclusion is not possible. More information about fault exclusion can be found in EN ISO 13849-2.

Changes to products or within assemblies from third-party suppliers used in this example can lead to the function no longer being ensured or the safety assessment having to be adapted. In any event, the information in the operating instructions on the part of EUCHNER, as well as on the part of third-party suppliers, must be used as the basis before this application is integrated into an overall safety function. If contradictions should arise between the operating instructions and this document, please contact us directly.

Use of brand names and company names

All brand names and company names stated are the property of the related manufacturer. They are used only for the clear identification of compatible peripheral devices and operating environments in relation to our products.

Euchner GmbH + Co. KG
Kohlhammerstraße 16
70771 Leinfelden-Echterdingen
info@euchner.de
www.euchner.com

Edition:
AP000254-01-01/20
Title:
Application CTM
Connection of CTM-LBI-BR.. to Safety Relay ESM-BA..1

Copyright:
© EUCHNER GmbH + Co. KG, 01/2020

Subject to technical modifications; no responsibility is accepted for the accuracy of this information.