

## EKS PROFINET Selection of Operating Mode with Pushbuttons



### Contents

Components/modules used.....	2
EUCHNER .....	2
Others .....	2
Abbreviations .....	2
Functional description.....	3
General.....	3
Electronic-Key structure and operating state.....	3
Block diagram and description .....	4
Programming in the safe control system .....	4
Programming in the PLC – evaluation of the EKS Electronic-Key.....	6
Programming in the PLC – evaluation of the serial feedback from the F-PLC.....	7
Programming in the PLC – lamp control .....	8
Principle circuit diagram.....	9
Safety assessment.....	10
General notes about programming.....	10
Access system .....	10
Selection system .....	11
Activation system.....	13
Important note – please observe carefully! .....	14

## Components/modules used

### EUCHNER

Description	Order no./item designation
EKS PROFINET compact	106305 / EKS-A-IIX-G01-ST02/03
or	or
EKS PROFINET modular with EKS FHM	122352 / EKS-A-AIX-G1EKS8 106585 / EKS-A-SFH-G30-2000 158353 / EKS-A-SFH-G30-3000 116118 / EKS-A-SFH-G30-ST150
EKS Electronic-Key	077859 / EKS-A-K1RDWT32-EU 084735 / EKS-A-K1BKWT32-EU 091045 / EKS-A-K1BLWT32-EU 094839 / EKS-A-K1GNWT32-EU 094840 / EKS-A-K1YEWT32-EU 123097 / EKS-A-K1WHWT32-EU 123098 / EKS-A-K1OGWT32-EU
Transponder coding	067190 / ANWPG TRANSPONDER CODING
MSC base unit	121289 / MSC-CB-AC-FI8FO2-121289
Six-piece terminal set for MSC	121321 / AC-SC-04-V06-121321

Tip: More information and downloads about the aforementioned EUCHNER products can be found at [www.euchner.com](http://www.euchner.com). Simply enter the order number in the search box.

### Others

Description	Item
S7-300, CPU 315F-2 PN/DP	6ES7315-2FJ14-0AB0 <sup>*)</sup>
SIMATIC DP, Power Module PM-E	6ES7138-4CA01-0AA0
Digital electronics module DI8/DO 8 DC24V	6ES7323-1BH01-0AA0
Totally Integrated Automation Portal Version V13 SP1	6ES7822-1AA04-0XC5
Pushbuttons	Any manufacturer; breaking capacity at least 100 mA/24 V DC

<sup>\*)</sup> Another safe PLC in addition to the EUCHNER MSC is **not** required. The application was verified exclusively via the standard PLC in this S7 CPU.

### Abbreviations

Abbreviation	Designation
EKS with PROFINET interface	The Electronic-Key-System with PROFINET interface used in this application (see EUCHNER components used and "Manual EKS and EKS FSA with PROFINET IO Interface" doc. no. 2516210)
PLC	The conventional programmable logic controller used and that offers PLC functionality.
F-PLC	The fail-safe programmable logic controller used in this application.

PL	Performance Level according to EN ISO 13849-1
PL <sub>r</sub>	Performance Level required according to EN ISO 13849-1
SRASW	Safety-related application software according to EN ISO 13849-1
MSO	Mode of Safe Operation. Selection of operating mode on a machine as required in various C standards (e.g. EN ISO 16090, EN ISO 23125, EN ISO 16089)

## Functional description

### General

Selection of operating mode is to be realized on a machine using the EKS with PROFINET interface as an access system. The operating mode is selected using pushbuttons. A key switch is not necessary. Evaluation and switchover of the operating mode are realized via a fail-safe control system (F-PLC). With the aid of the EKS, five typical access rights for access to the operating mode selection can be defined. Which operating modes the owner of the related Electronic-Key can select depends on the access rights.

### Electronic-Key structure and operating state

The data on the Electronic-Key are structured as follows, for example:

Byte no.	Description	Type	Length	Explanation
5	Access rights	Byte	1 byte	Authorization level for access to the machine's operating mode
116 – 123	KeyID	KeyID	8 byte	The KeyID is a number that is permanently pre-programmed on the Electronic-Key by EUCHNER. This number is different for each Electronic-Key.

The access rights are saved in byte no. 5 in this application. The value and the position of the bytes required for the access rights can be selected as required by the customer in the programmable memory in the Electronic-Key. The access rights are available in the input area of the control system after positioning the Electronic-Key and represent a valid value. The assignment of the byte value to the operating mode is described in Table 1.

Operating mode	Hex	Meaning	Symbol
MSO_0	01	Mode of Safe Operation 0: Manual mode	
MSO_1	02	Mode of Safe Operation 1: Automatic mode	
MSO_2	03	Mode of Safe Operation 2: Setup mode	
MSO_3	04	Mode of Safe Operation 3: Automatic mode with manual intervention	
MSO_SE	05	Mode of Safe Operation Service: Operating mode for servicing and setup	

Table 1

### Block diagram and description

The 4 operating modes MSO\_1 to MSO\_SE can be set on the machine in this example. Operating mode MSO\_0, "Manual," is not available on fully automatic machines.

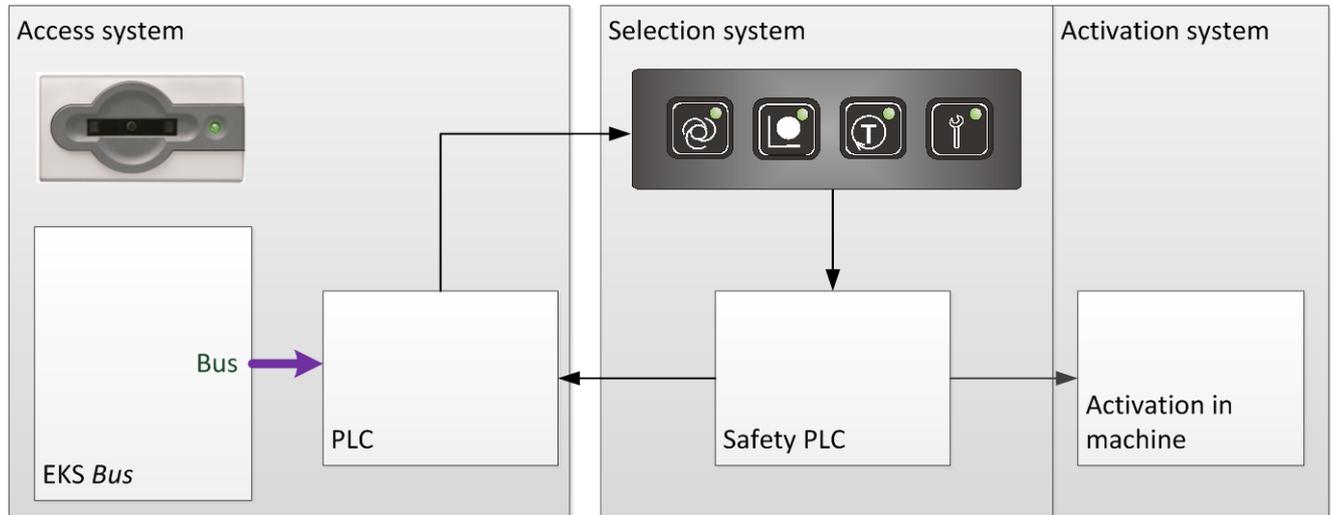


Figure 1

The highest permissible operating mode (access rights) is entered on each of the Electronic-Keys. For example, a person authorized to work in setup mode can always work in automatic mode as well. The EKS with PROFINET interface reads the access rights from the Electronic-Key and forwards this information to the input area of the conventional PLC.

The PLC now enables the access rights by enabling all permissible pushbuttons. The PLC then uses signal lamps in the pushbuttons to indicate which operating mode may be selected. In the event of an error, the pushbuttons for selection of operating mode will not be enabled.

The F-PLC reads the selected operating mode when a pushbutton is pressed. Here too, only one pushbutton may be pressed at a time (1-of-N selection). Pressing more than one pushbutton must cause the system to branch to an error mode that is left only when only one or no pushbutton is still pressed. Defective pushbuttons can be detected this way. Furthermore, the operating mode is switched only when the pushbutton is released (falling edge). This ensures that there is no short circuit in the cable and that no pushbutton is faulty.

The F-PLC will activate the new operating mode when the machine is in a suitable state. A message is simultaneously sent to the PLC to indicate the selected operating mode. With the safety control system used, this feedback is provided via a serial channel. Parallel feedback via inputs and outputs is also possible as an alternative. The PLC indicates the selected operating mode.

No other operating mode can be selected after the EKS Electronic-Key is removed.

### Programming in the safe control system

The inputs are connected to a single-channel SWITCH input in the F-PLC. A logic function comprising an AND gate and an OR NOT gate is used to check whether exactly one input is set in each case. The output of the AND gate is connected to an edge-triggered USER RESTART MONITORED memory module that assumes the logical 1 state (LL1) on its output with the falling edge (release of the pushbutton for selection of operating mode). This operating mode remains selected until another operating mode is selected or an error is detected. The USER RESTART MONITORED memory module is cleared by selecting a different operating mode OR by an error. An error output is set if several pushbuttons are pressed simultaneously. This error output resets all memory outputs.

Synchronous serial data transmission is used for messages to the PLC. The four operating modes and the fault display are sent. With serial data transmission from the MSC, a pause is observed between the characters. The output is set to 1 during this time. The time is adjustable. The PLC synchronizes itself with this pause. A valid bit is then transmitted with every falling edge on the CLK output. The part of programming that involves sending a message to the PLC is not relevant to safety.

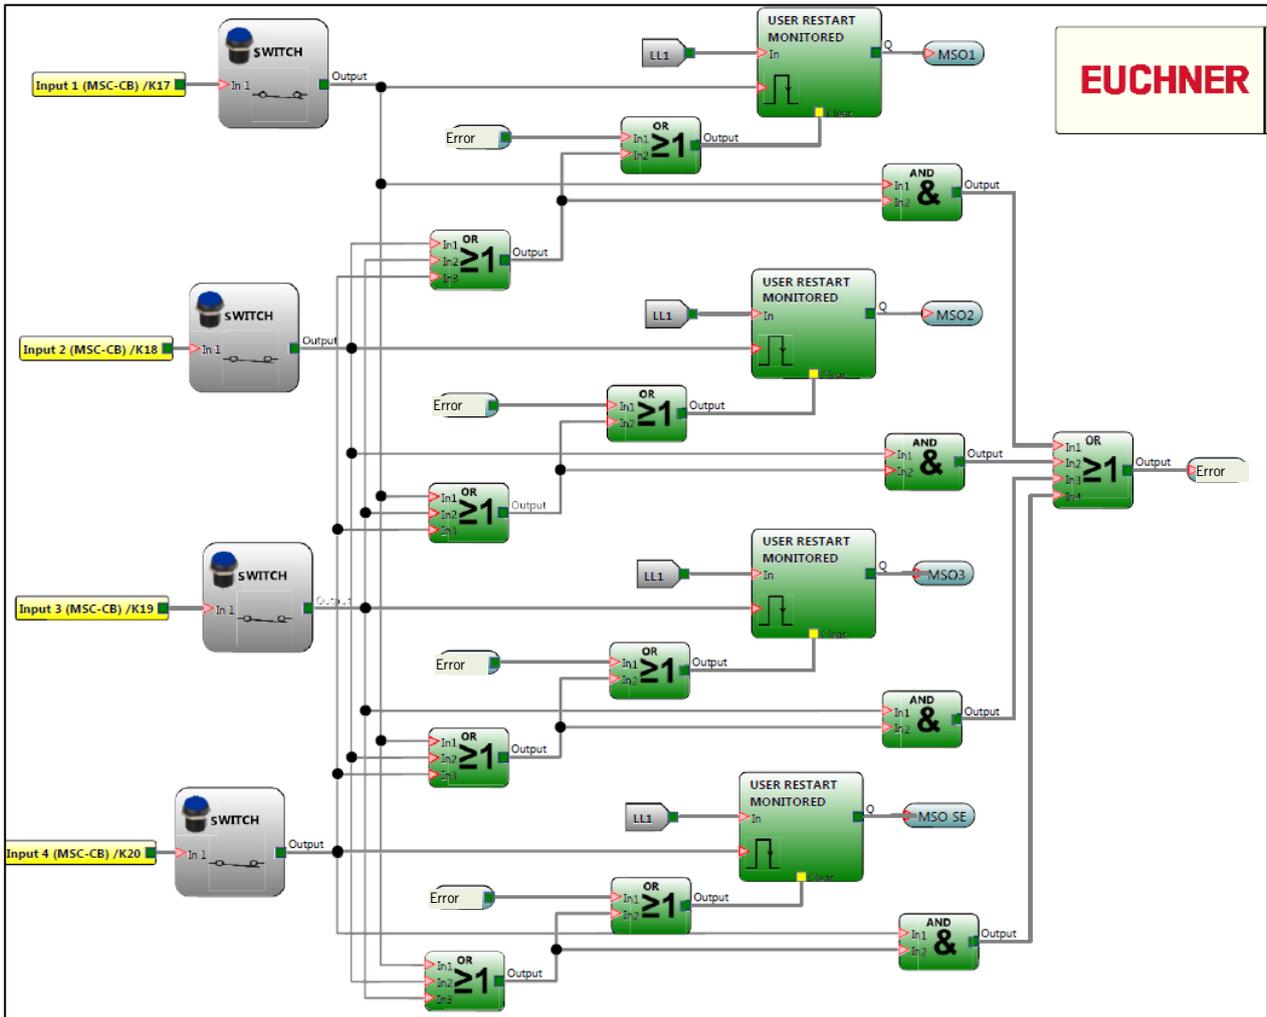


Figure 2

The data can be sent to the PLC either via five monitoring outputs in parallel or, with the MSC, also via serial data transmission. The message includes both the currently selected operating mode and any pending error message.

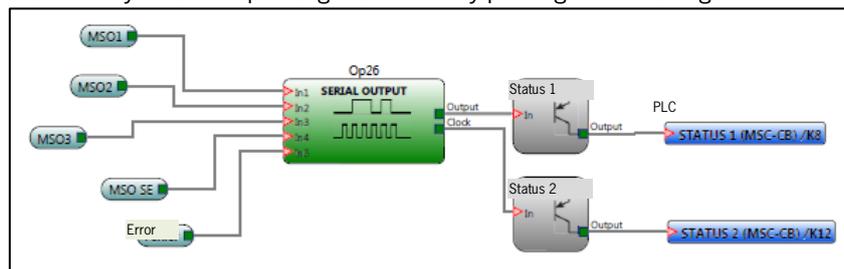


Figure 3

A bit duration of 40 ms and an inter-character time of 100 ms are set as values for serial transmission.

## ***Programming in the PLC – evaluation of the EKS Electronic-Key***

The EKS with PROFINET interface must be configured in a configuration software application from Siemens using the GSDML file. The access rights saved on the Electronic-Key must be evaluated using the PLC programming. The PLC enables the outputs connected to the pushbuttons depending on the access rights.

**Programming in the PLC – evaluation of the serial feedback from the F-PLC**

Data are read from the safe PLC via synchronous serial data transmission. Data are sent on one input, and a CLK signal is sent for synchronization on the second one. The respective bit is always read on the falling edge of the CLK signal. Figure 4 shows the procedure in principle. Whenever an error occurs, it is attempted to perform synchronization again. The five bits sent in the safe control system must be assigned to the respective state.

The timer must be adapted to the inter-character time in the MSC. A timeout must always be reached before the first bit arrives. With an 80 ms timer, the cycle time in the PLC must be less than 20 ms for this purpose.

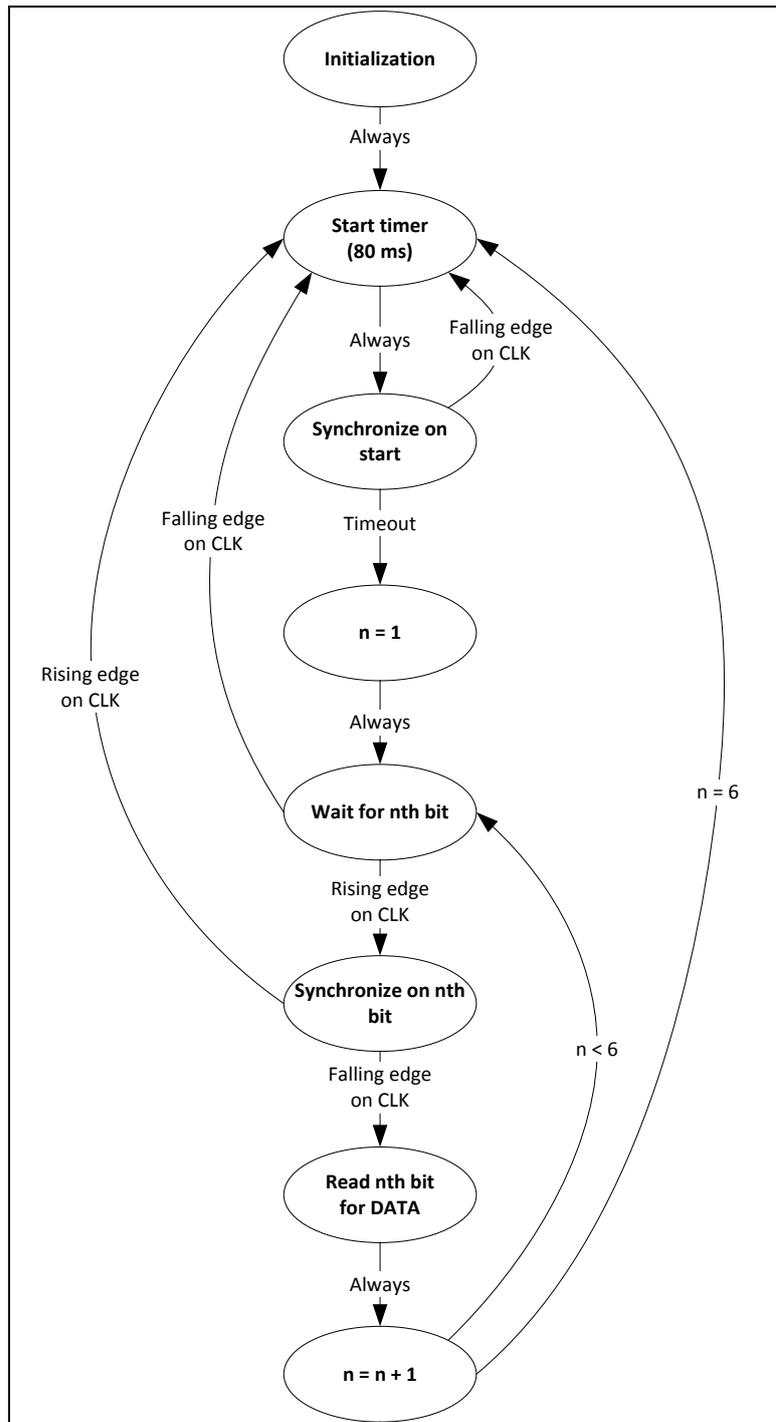


Figure 4

**Programming in the PLC – lamp control**

Lamps are included in the pushbuttons for selecting the operating mode. These lamps flash to indicate the selectable operating mode, and they illuminate continuously to indicate the currently selected operating mode. The currently selected operating mode is indicated by continuous illumination in the “Flash H...” states. Flashing of all selectable operating modes is achieved by repeatedly cycling through all states for indication during flashing.

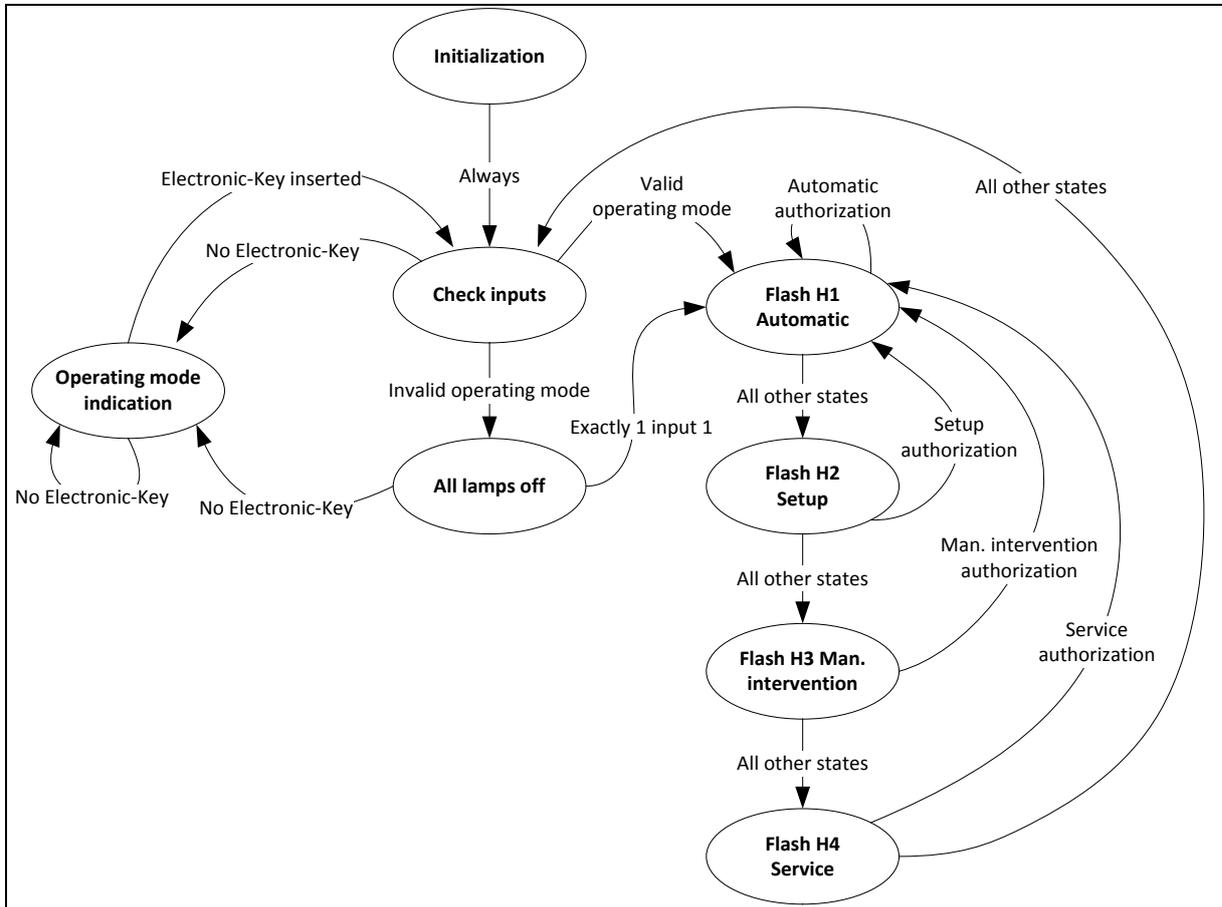


Figure 5

**Principle circuit diagram**

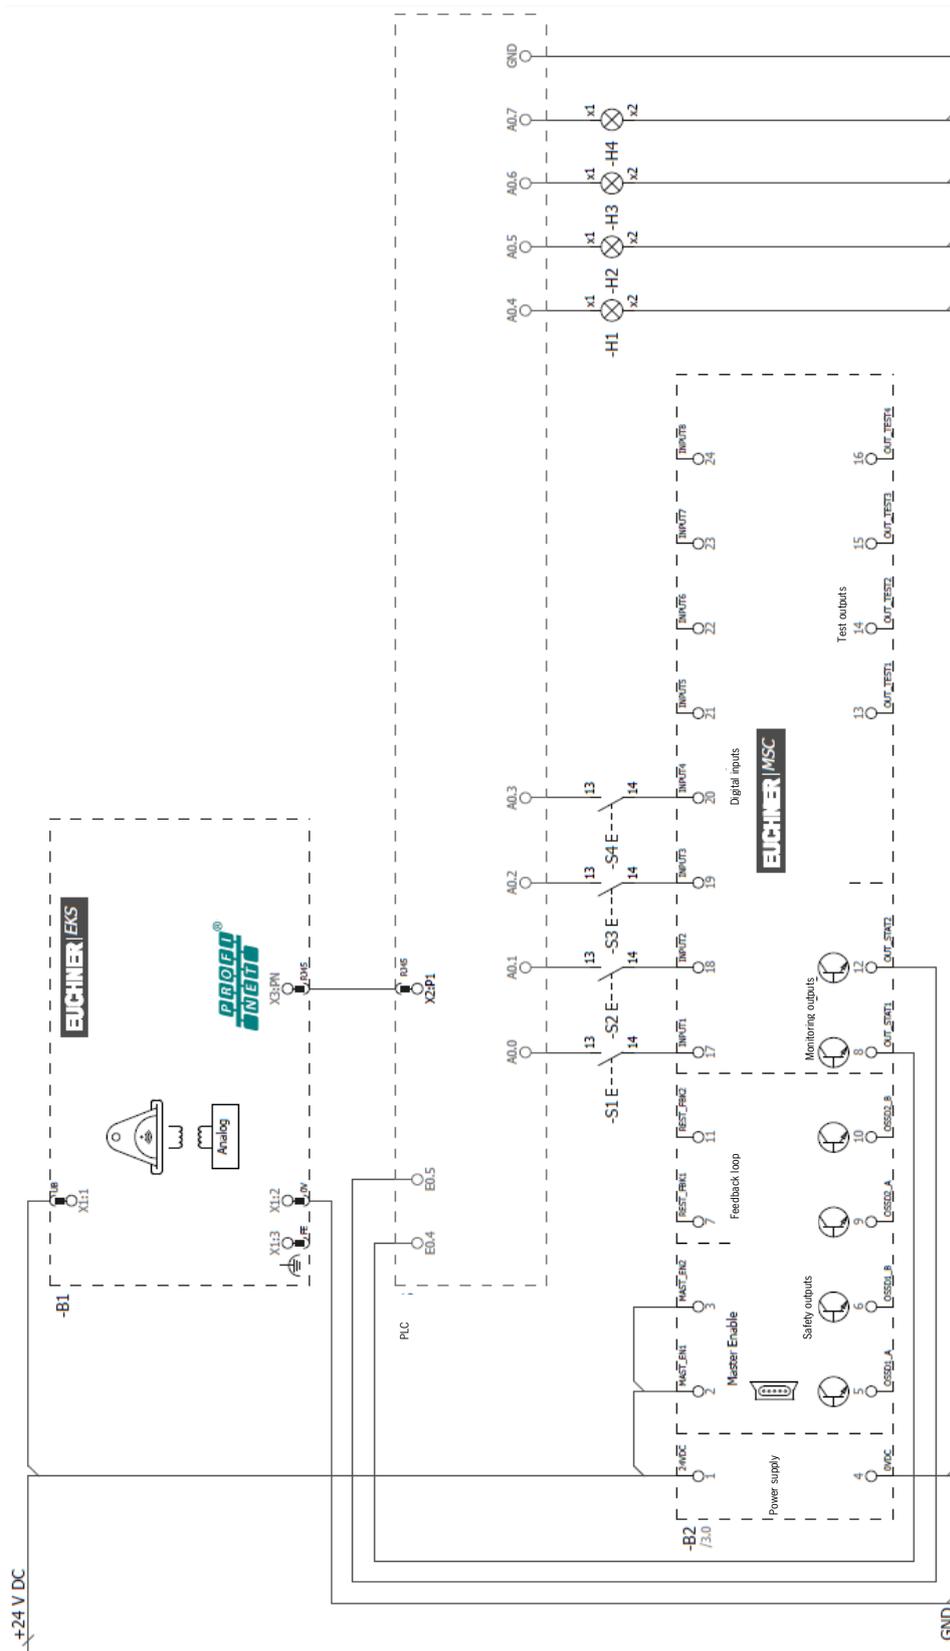


Figure 6

No responsibility is accepted for the accuracy of this information. Subject to technical modifications; errors excepted. © EUCHNER 2018

## Safety assessment

Selection of operating mode is subdivided into three blocks – access system, selection system and activation system. DGUV Information “Sicherheitsbezogene Betriebsarten” (“safety-related operating modes”) from the German Social Accident Insurance (DGUV) (Fachbereich Holz und Metall/wood and metal department) contains further details about this subdivision.

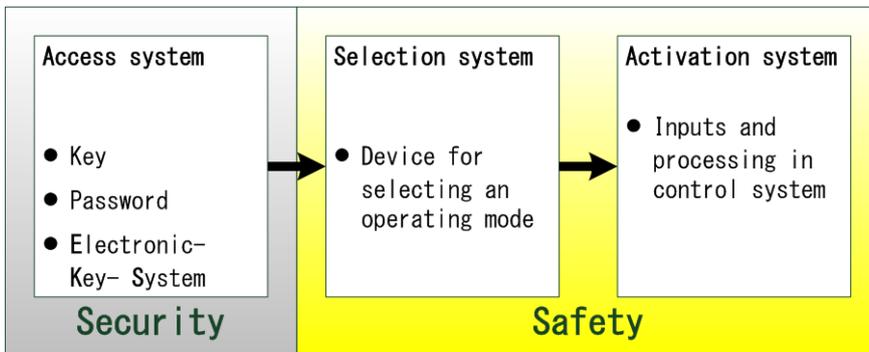


Figure 7

## General notes about programming

Programming in the safe PLC is relevant for safety and must be performed in accordance with section 4.6 of EN ISO 13849-1. The software must be validated according to EN ISO 13849-2.

## Access system

The access system consists of the EKS and the PLC. The access system does not have to fulfill any safety functions with regard to the safety of machinery. It does not require a PL. This part of selection of operating mode serves to restrict access. The EKS, in combination with evaluation by the PLC, is well protected against tampering and misuse. Copying Electronic-Keys can be effectively prevented, e.g. by using a checksum routine (see application AP000169-5). When an Electronic-Key with a valid value is read, the PLC outputs to which pushbuttons S1 to S4 are connected are set. Only the outputs enabled by the Electronic-Key content are enabled.

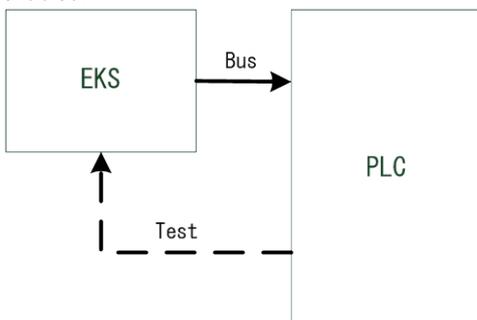


Figure 8

### Selection system

Safety classification is required for the selection system and activation system. These two system parts must fulfill the PL, resulting from the risk assessment for the respective machine. The selection system consists of the selection pushbuttons and the safe PLC. The safe PLC in this example is the MSC from EUCHNER. Its hardware fulfills PL e. The category and the MTTFd for the pushbuttons must be determined. The activation system is not considered in the application; it must be calculated separately. It will typically consist of contactors and/or valves.

The safety engineering structure corresponds to Figure 9 or Figure 10. The input side (pushbuttons) corresponds to category 2 and the output side to category 4. The safe PLC monitors the single-channel pushbuttons' functions. The safe PLC fulfills PL e. The activation system consists of contactors or valves. They must also be designed to be monitored.

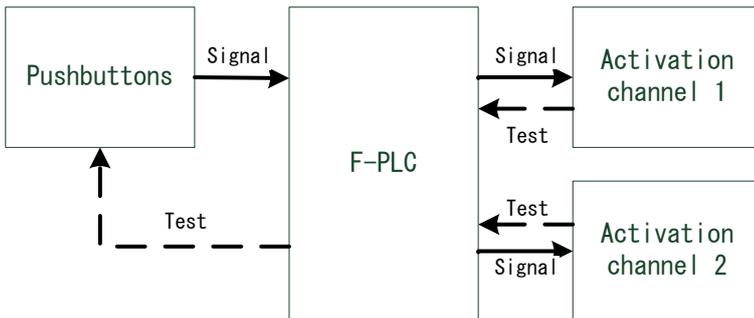


Figure 9

The overall circuit is subdivided into subsystems to calculate the safety values using the SISTEMA software.

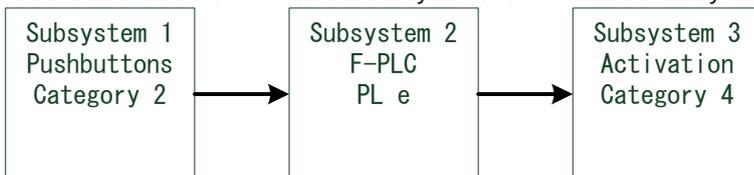


Figure 10

Each subsystem is calculated separately.

#### Selection system: subsystem 1 – pushbuttons

The subsystem fulfills the requirements for category 2.

Basic safety principles according to EN ISO 13849-2 are observed:

- Application of the energy separation principle – the operating mode can be changed only when voltage is applied.
- Suitable protection against ingress of fluids and dust – the required IP degree of protection must be met.

Proven safety principles according to EN ISO 13849-2 are observed:

- Overdimensioning – the pushbuttons must be able to switch ten times the current required by the safe PLC at the inputs.
- Reduction of the failure modes – the safety-related function is separated from the other functions.

The pushbuttons'  $B_{10d}$  values are required for calculation. If the values are not available from the pushbuttons' manufacturer, the value 1,000,000 can be used instead (source: BGIA Report 2/2008, Table D.2). In this case, pushbuttons must be used that are capable of switching at least ten times the current required by the safe PLC at the inputs.

Position switches and pushbuttons <sup>b)</sup> with resistive load and overdimensioned ( $\leq 10\%$ of the maximum load) referred to the electrical contacts	Tables D.1 and D.2	IEC 60947 EN 1088	$B_{10d} = 1,000,000$
--	--------------------	----------------------	-----------------------

b) For normally open contacts and for normally closed contacts if fault exclusion for positively driven opening is not possible

Figure 11

This value can be used to determine the pushbuttons'  $MTTF_d$ . Assuming that the operating mode is changed 100 times a day, the resulting  $MTTF_d$  is 273 years.

Fault detection in the safe PLC is performed according to two principles. Switchover to another operating mode takes place only with a falling edge at an input of the safe PLC. Additionally, only one input may be set.

Component	Possible failure	Fault detection	Effect / reaction
Pushbutton	Does not open	The operating mode is accepted only with a falling edge.	Failure in the safe direction
		Pressing another pushbutton deactivates the previously selected operating mode. This completely switches off the machine.	Leads to complete shutdown of the machine
	Does not close	The fault cannot be detected, but it does not represent a dangerous failure. This operating mode can no longer be selected in this case.	Failure in the safe direction
	Short circuit to 0 V on pin 13 of a pushbutton	The fault cannot be detected, but it does not represent a dangerous failure. This operating mode can no longer be selected in this case.	Failure in the safe direction
	Short circuit to 24 V on pin 13 of the pushbutton	The fault cannot be detected. The associated operating mode can always be selected. The fault can be assigned to the access system and does not have to be considered from a safety engineering perspective.	Fault is not detected
	Short circuit to 0 V on pin 14 of a pushbutton	The fault cannot be detected, but it does not represent a dangerous failure. This operating mode can no longer be selected in this case.	Failure in the safe direction
Short circuit to 24 V on pin 14 of a pushbutton	This fault produces a rising edge. A falling edge can no longer be produced.	Failure in the safe direction	
	Pressing another pushbutton deactivates the previously selected operating mode. This completely switches off the machine.	Leads to complete shutdown of the machine	

Table 2

Of the six different, mutually independent faults in Table 2, 4.5 (only partial detection is assumed for one of the faults) are detected. The diagnostic coverage for the pushbuttons is therefore 83%.

The structure for subsystem 1 is mapped in SISTEMA.

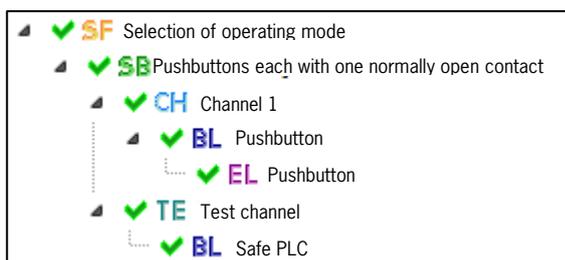


Figure 12

A value of 100 years can be entered directly as the  $MTTF_d$  for the safe PLC in the test channel.

With the stated values, the following values result for subsystem 1.

Category: 2

MTTF<sub>d</sub>: 100 years (high)

DC<sub>avg</sub>: 83% (low)

CCF: this must be verified by the application's creator and must produce a result of a least 65 points.

PL: d

PFH<sub>d</sub>: 2.99E-07

**Important:** The specified PFH<sub>d</sub> must be calculated for the number of changes in the selection of operating mode for each application. The specified PFH<sub>d</sub> is calculated for 36,500 actuations per year.

### **Selection system: subsystem 2 – safe PLC**

The MSC-CB from EUCHNER is subsystem 2. EUCHNER confirms category 4, PL e and a PFH<sub>d</sub> value of 6.1 E-09 for this system.

**Important:** The software in the safe PLC must be created as per PL d according to EN ISO 13849-1 and must be validated correspondingly.

### **Selection system: result for subsystems 1 and 2**

With the values assumed above, the resulting PFH<sub>d</sub> for both subsystems together is 3.85 E-07, which corresponds to PL d.

## **Activation system**

### **Activation system: subsystem 3**

The activation system is not considered here. It can be calculated as a separate subsystem and added to the PFH<sub>d</sub> of subsystems 1 and 2.

## **Important note – please observe carefully!**

This document is intended for a design engineer who possesses the requisite knowledge in safety engineering and knows the applicable standards, e.g. through training for qualification as a safety engineer. Only with the appropriate qualification is it possible to integrate the example provided into a complete safety chain.

The example represents only part of a complete safety chain and does not fulfill any safety function on its own. In order to fulfill a safety function, the energy switch-off function for the danger zone and the software within the safety evaluation must also be considered, for example.

The applications provided are only examples for solving certain safety tasks for protecting safety doors. The examples cannot be comprehensive due to the application-dependent and individual protection goals within a machine/installation.

### **If questions concerning this example remain open, please contact us directly.**

According to the Machinery Directive 2006/42/EC, the design engineer of a machine or installation has the obligation to perform a risk assessment and take measures to reduce the risk. While doing this, the engineer must comply with the applicable national and international safety standards. Standards generally represent the current state-of-the-art. Therefore, the design engineer should continuously inform himself about changes in the standards and adapt his considerations to them. Relevant standards include EN ISO 13849 and EN 62061. This application must be regarded only as assistance for the considerations about safety measures.

The design engineer of a machine/installation has the obligation to assess the safety technology him/herself. The examples must not be used for an assessment, because only a small excerpt of a complete safety function was considered in terms of safety engineering here.

In order to be able to use the safety switch applications correctly on safety doors, it is indispensable to observe the standards EN ISO 13849-1, EN ISO 14119 and all relevant C-standards for the respective machine type. Under no circumstances does this document replace the engineer's own risk assessment, and it cannot serve as the basis for a fault assessment.

In particular in relation to a fault exclusion, it must be noted that a fault can only be excluded by the machine's or installation's design engineer and this action requires justification. A general fault exclusion is not possible. More information about fault exclusion can be found in EN ISO 13849-2.

Changes to products or within assemblies from third-party suppliers used in this example can lead to the function no longer being ensured or the safety assessment having to be adapted. In any event, the information in the operating instructions on the part of EUCHNER, as well as on the part of third-party suppliers, must be used as the basis before this application is integrated into an overall safety function. If contradictions should arise between the operating instructions and this document, please contact us directly.

### **Use of brand names and company names**

All brand names and company names stated are the property of the related manufacturer. They are used only for the clear identification of compatible peripheral devices and operating environments in relation to our products.